


- LEGEND:**
- Ex. Watermain/Service —
  - Ex. Telephone Cable —
  - Ex. Gasmain/Service —

**NOTES:**  
 1. Contractor shall Hydrovac to confirm depth and location of existing utilities prior to construction

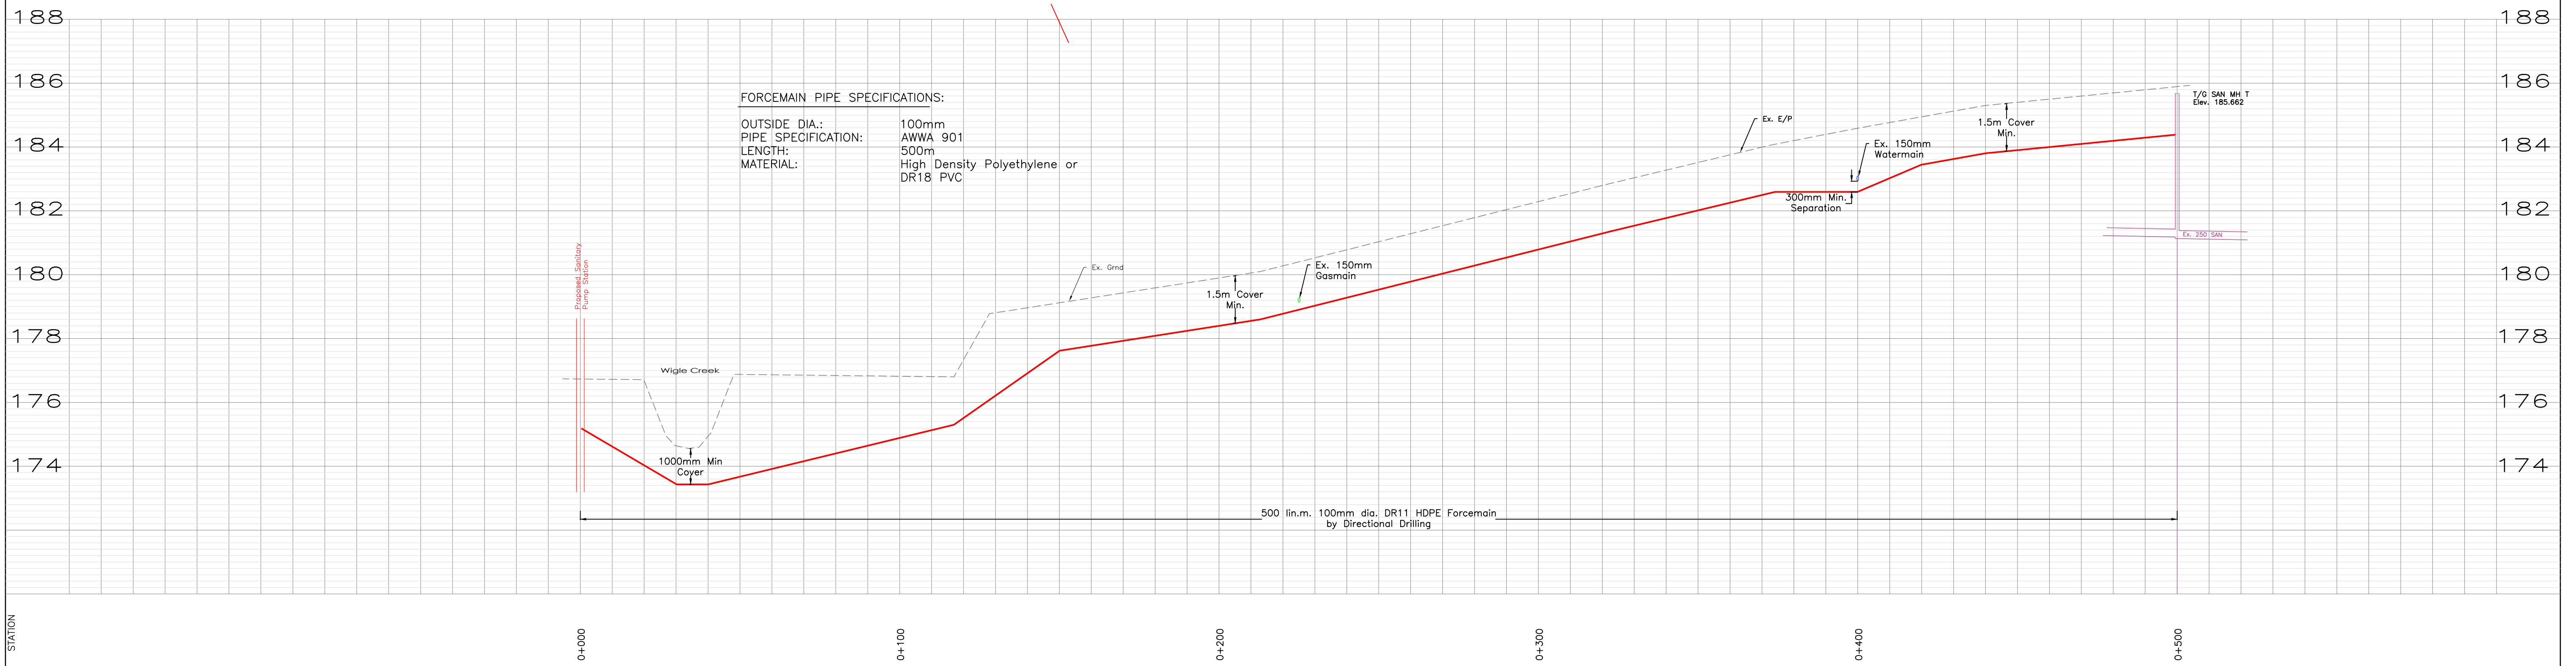

**FORCEMAIN PIPE SPECIFICATIONS:**  
 OUTSIDE DIA.: 100mm  
 PIPE SPECIFICATION: AWWA 901  
 LENGTH: 500m  
 MATERIAL: High Density Polyethylene or DR18 PVC

AS CONSTRUCTED NOTES	AS CONSTRUCTED SERVICES	COMPLETION	No.	REVISIONS	DATE	BY
1 SEE DRAWING NO. FOR FURTHER DETAIL.	DESIGN	WJB		ISSUED FOR WORK PERMIT	07/29/19	
2 SEWER DESIGN: TRANSITION WIDTH OR AS NOTED	CHECKED	WJB	1	Forcemain Location	09/16/19	WJB
3 REFERENCE B.M. ELEVATION	APPROVED		2	Utility Locates	11/18/19	WJB
			3	Add Survey Info Forcemain Easement	04/20/20	WJB
	DATE					
	F.B.K. 7					

**Notes:**  
 The position of Pole Lines, Conduits, Watermains, Sewers, Gasmain and other Underground and Overhead Utilities and Structures are not necessarily shown on the Drawings, and where they are shown, the location is based on locates provided by G-Tel (Oct. 2018) and the Town of Kingsville (Sept. 2019) and the accuracy of the position of such Utilities and Structures is not guaranteed. Prior to commencing construction, the Contractor shall ascertain the exact Location and Elevation of all such Utilities and Structures and shall assume all liability for any Damage to them.

**Benchmarks:**  
 1. Top of First Concrete Step on West side of Office, Pleasant Valley Campground. Elev. 178.107  
 2. NE Corner of Bridge curb Elev. 179.077

	<b>CONSULTANT</b> <b>NORTHWEST CONSULTING</b> 6908 MAPLE STREET, RR 2 CAMLACHIE, ONTARIO N0N 1E0 TEL: 519-868-8855 EMAIL: NORTHWEST@COGECO.CA		<b>SCALE</b> HORIZONTAL - 1 : 1000 1.0 0 20m VERTICAL - 1 : 100 1.0 0 2.0m	<b>TITLE</b> <b>FORCEMAIN PLAN/PROFILE</b>	<b>DATE</b> July 29, 2019
				<b>PLEASANT VALLEY CAMPGROUND          SANITARY CONNECTION TO          TOWN of KINGSVILLE SYSTEM</b>	<b>SHEET No.</b> 1 of 1 <b>PLAN FILE No.</b> 12060